


WTC 49918  
M-1 5/16/98

DRAWING NUMBER

DATE

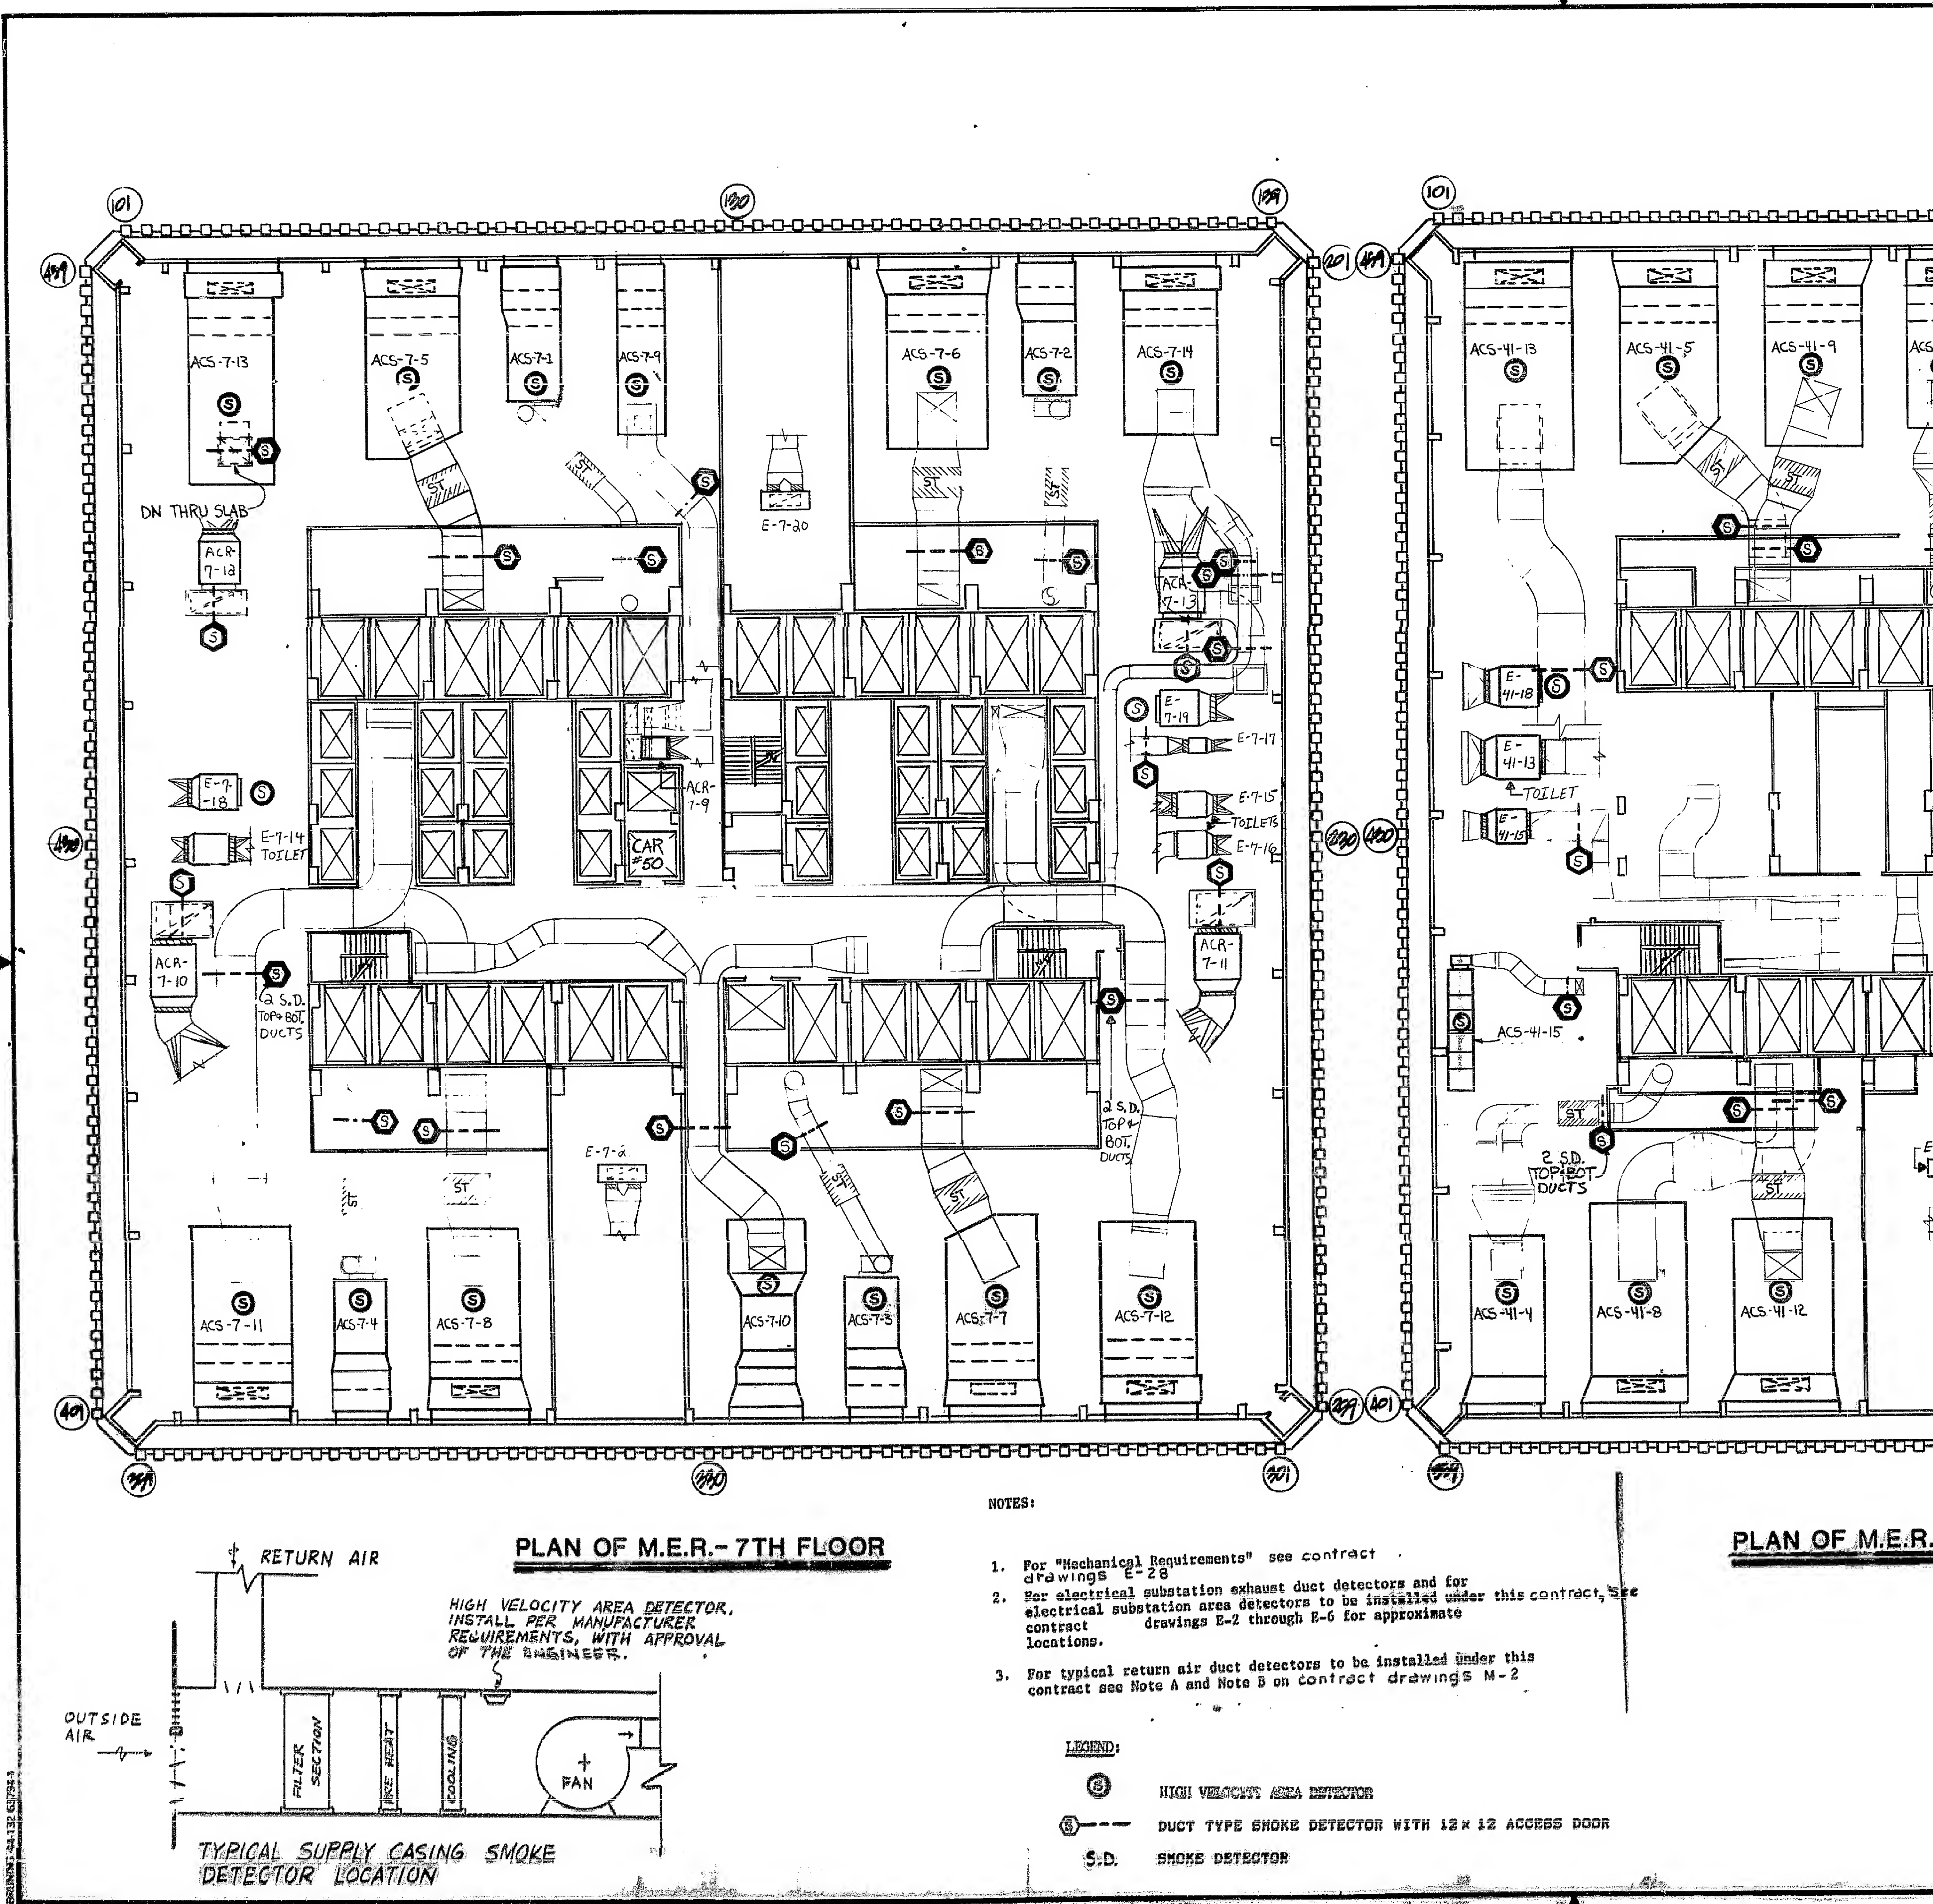

PLAN OF M.E.R.-7TH FLOOR

PLAN OF M.E.R.

NOTES:

1. For "Mechanical Requirements" see contract drawings E-28
2. For electrical substation exhaust duct detectors and for electrical substation area detectors to be installed under this contract, see contract drawings E-2 through E-6 for approximate locations.
3. For typical return air duct detectors to be installed under this contract see Note A and Note B on contract drawings M-2

LEGEND:

- (X) HIGH VELOCITY AREA DETECTOR
- (.) DUCT TYPE SMOKE DETECTOR WITH 12 x 12 ACCESS DOOR
- S.D. SMOKE DETECTOR

